

Viša Tasić^{*1}, Vladan Kamenović^{*2}, Tamara Urošević^{*3}, Bojan Radović^{*4},
Tatjana Apostolovski-Trujić^{*5}, Zvonko Damjanović^{**}

SUSPENDED PARTICLES CONCENTRATIONS IN THE SECONDARY SCHOOLS IN BOR (SERBIA) IN HEATING SEASON^{***}

Orcid: 1) <https://orcid.org/0000-0001-6710-6529>; 2) <https://orcid.org/0000-0001-9476-5378>;
3) <https://orcid.org/0000-0002-9838-3702>; 4) <https://orcid.org/0000-0003-4884-1418>;
5) <https://orcid.org/0000-0002-9369-160X>

Abstract

This paper presents the results of measurements the suspended particles of the PM_{10} and $PM_{2.5}$ fractions in two high schools in Bor (School of Mechanical and Electrical Engineering - MS and Grammar School - GM). The measurements were conducted in two heating seasons for a duration of seven days (five weekdays, and two weekend days). Periods during the weekdays when there were classes and weekend days when there were no classes at school were analyzed separately. The measurement results show that the average concentrations of suspended particles PM_{10} during the class period were 1.7 (GM) and 2.4 (MS) times higher than in the period without classes. The average concentrations of suspended particles $PM_{2.5}$ in both schools during the class period were 1.5 times higher than in the period without classes. In MS the average PM_{10} and $PM_{2.5}$ concentrations during classes were above daily limit values for 3 of 5 working days. In contrast, there was no exceeding of the average daily limit values for concentrations of suspended particles during classes in GM. The results of measurements indicate that more attention should be paid to the way classrooms are cleaned to reduce the possibility of particles resuspension due to the movement of pupils during the teaching period.

Keywords: classroom, real-time monitoring, particulate matter, air pollution

1 INTRODUCTION

The most studied and most frequently mentioned environmental pollution is the air pollution. Long-term exposure to the low concentrations of pollutants is a particular problem, which is the most common case [1-3]. The difficulty in study the effects of air pollution on health is the presence of a mixture of pollutants in the air, which is almost always the case making it difficult to single out the individual impacts. EU and national

legislation have prescribed the monitoring of two fractions of particles present in the air, particles smaller than 2.5 μm in diameter, and coarse particles that are 2.5-10 μm in diameter [4]. The introduction of limit values for pollutant concentrations in the ambient air, especially those related to the suspended particles, contributes to improving the population health.

* Mining and Metallurgy Institute Bor, Zelene bulevar 35, 19210 Bor, Serbia,
e-mail: visa.tasic@irmbor.co.rs

** Computer Centre Bor, Trg Oslobođenja 8, 19210 Bor, Serbia

*** This work was financially supported by the Ministry of Science, Technological Development and Innovation of the Republic of Serbia, Grant No. 451-03-47/2023-01/200052.

The urban air quality is thought to have a more significant impact on population health than the other environmental factors, and the ambient air pollutants are one of the most significant causes of health problems in general. According to the WHO (World Health Organization), over 4 million deaths occur annually in the world due to the air pollution [5]. Many of the adverse health effects come from the inhalation of increased concentration of particulates from the ambient air. A very important impact on human health has particles with a diameter of less than $2.5 \mu\text{m}$. The consequences of a large uptake of these particles into the lungs are usually respiratory infections and, in extreme cases, death. People suffering from asthma, heart or lung disease are most vulnerable to particulate pollution [6 -9].

It is very important to determine the impact of indoor PM concentrations on human health because people spend most of their lives indoors [10]. In the indoor environment, both indoor and outdoor sources contribute to PM levels. The PM in indoor air originates from outdoor infiltration and additional indoor sources such as cooking and heating devices, tobacco smoking, building materials, etc. Indoor air quality in educational buildings is of great importance

since children and students spend a large part of their time in classrooms. Unfortunately, there are almost no systematic monitoring programs dealing with the indoor air quality in educational buildings in the Republic of Serbia. This work presents the result of an ongoing study on student's and teacher's exposure to the suspended particles PM_{10} and $\text{PM}_{2.5}$ in two secondary schools (School of Mechanical and Electrical Engineering - MS and Grammar School - GM) in Bor, Serbia.

2 METHODOLOGY

Both schools (MS and GM) are located in the Bor town residential area, about 2 km southwest of the copper smelter facilities, as shown in Figure 1. The indoor measurements of suspended particles at each school were conducted at one selected classroom located on the second floor. Both classrooms have a floor space of approximately 60 m^2 and volumes of 240 m^3 . The floor is covered with the worn wooden parquet. There is no air conditioning system in the classrooms. The window areas in both classrooms are about 8 m^2 . The classrooms are occupied by 15-30 pupils during teaching hours. During the measurements campaign (heating season), the schools were heated regularly using the remote district heating system.

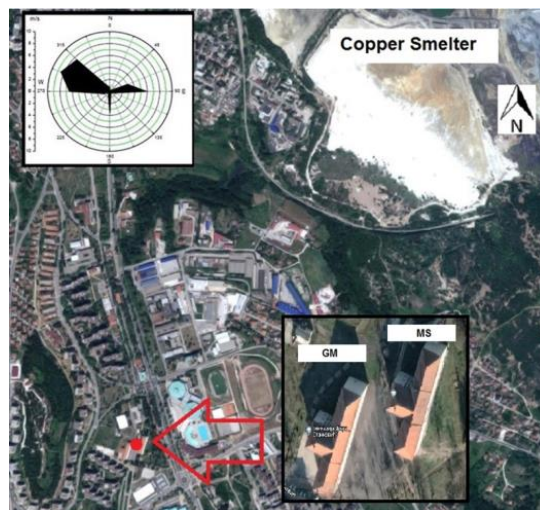


Figure 1 The position of MS and GM schools on the Bor town map

3 RESULTS AND DISCUSSION

The measurements of suspended particulate matter, PM₁₀ and PM_{2.5} fractions, were carried out simultaneously in the classroom and outdoor air, for five consecutive working days (Monday - Friday) and two non-working days (Saturday-Sunday). The measurement of indoor PM concentrations was carried out with a Turnkey Osiris real-time PM monitor [11]. The results of measurements were analyzed separately for the teaching hours (PP - pupils present), from 7 AM - 3 PM, and no teaching hours (PA - pupils absent), from 3 PM to 7 AM in the morning of following day. The measurement of outdoor PM concentrations were carried out with a Grimm EDM180 PM monitor at the National Air Quality Monitoring Station (NAQMS) Bor Town Park (TP) (44°04'33"N, 22°05'58"E).

The average PM₁₀ levels measured in the classrooms at MS and GM are shown in Table 1. According to data shown in Table 1, the average daily concentration of PM₁₀ in the classroom at MS was 31.5 µg/m³. At the same time, the average daily concentration of PM₁₀ in the ambient air was 25.5 µg/m³. Also, the average concentration of PM₁₀ in the classroom at MS during the teaching period was 46.2 µg/m³. This is 1.7 times higher PM₁₀ concentration compared with the PM₁₀ concentration recorded in the no teaching period (27.2 µg/m³). In MS the average PM₁₀ concentrations during classes were above daily limit values for 3 of 5 working days.

Table 1 Average PM10 levels and I/O ratios measured in the classrooms at MS and GM (PP - pupils present, PA - pupils absent)

MS working days						
Date	PM ₁₀ IN 24h	PM ₁₀ OUT 24h	PM ₁₀ IN/OUT 24h	PM ₁₀ IN PP	PM ₁₀ IN PA	PM ₁₀ IN PP/PA
	µg/m ³	µg/m ³		µg/m ³	µg/m ³	
21/01/19	25.6	27.5	0.9	21.6	26.1	0.8
22/01/19	41.8	28.2	1.5	54.2	32.3	1.7
23/01/19	31.5	30.7	1.0	57.8	28.8	2.0
24/01/19	31.2	21.0	1.5	50.3	26.7	1.9
25/01/19	28.9	20.3	1.4	46.9	23.3	2.0
Average	31.5	25.5	1.3	46.2	27.2	1.7
MS weekend days						
27/01/19	5.3	32.5	0.2	6.0	5.5	1.1
28/01/19	11.3	26.3	0.4	12.1	12.7	1.0
Average	8.3	29.4	0.3	9.1	9.1	1.0
GM working days						
Date	PM ₁₀ IN 24h	PM ₁₀ OUT 24h	PM ₁₀ IN/OUT 24h	PM ₁₀ IN PP	PM ₁₀ IN PA	PM ₁₀ IN PP/PA
	µg/m ³	µg/m ³		µg/m ³	µg/m ³	
13/03/23	6.8	22.3	0.3	9.1	4.9	1.9
14/03/23	7.2	36.2	0.2	11.1	5.3	2.1
15/03/23	17.2	28.1	0.6	30.8	11.8	2.6
16/03/23	17.4	11.8	1.5	33.2	13.0	2.6
17/03/23	16.8	12.0	1.4	30.9	13.1	2.4
Average	13.1	22.1	0.8	23.0	9.6	2.3
GM weekend days						
18/03/23	9.4	32.8	0.3	9.7	5.8	1.7
19/03/23	5.1	22.8	0.2	4.5	10.1	0.4
Average	7.3	27.8	0.3	7.1	8.0	1.1

The average PM_{10} levels measured in the classroom at GM was $13.1 \mu\text{g}/\text{m}^3$. At the same time, the average daily concentration of PM_{10} in the ambient air was $22.1 \mu\text{g}/\text{m}^3$. Also, the average concentration of PM_{10} in the classroom at GM during the teaching period was $23.0 \mu\text{g}/\text{m}^3$. This is 2.3 times higher average PM_{10} concentration compared with the PM_{10} concentration recorded in the no teaching period ($9.6 \mu\text{g}/\text{m}^3$).

It can be seen from the presented data that even though in the observed periods,

the average daily concentration of PM_{10} in the outdoor air was approximately the same, the average daily concentration of PM_{10} in MS was significantly higher compared to the average daily concentration of PM_{10} in GM. We believe that the different practices of aeration and cleaning, as well as the long presence and large number of students in the classroom in MS compared to the GM, caused such results. This can be confirmed on the basis of changes in PM_{10} concentrations, shown in Figures 2 and 3.

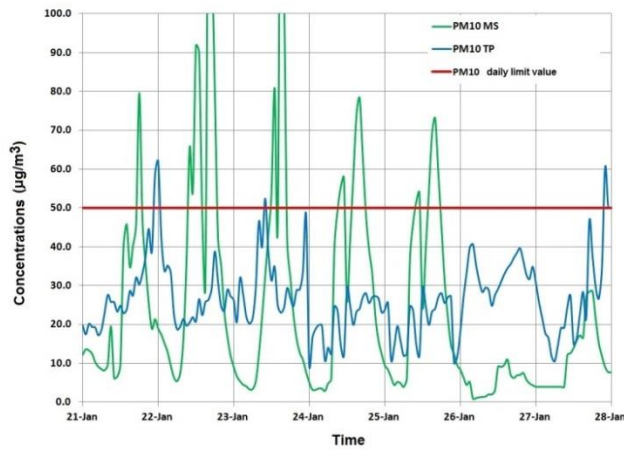


Figure 2 Line diagram of PM_{10} measured in MS and outdoor air at TP

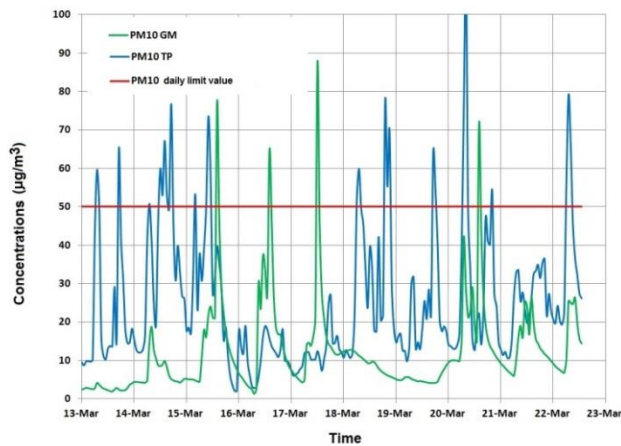


Figure 3 Line diagram of PM_{10} measured in GM and outdoor air at TP

The average PM_{2.5} levels, measured in the classroom at MS, are shown in Table 2. According to data shown in Table 2, the average daily concentration of PM_{2.5} in the classroom at MS was 17.6 µg/m³. At the same time, the average daily concentration of PM_{2.5} in the ambient air was 21.1 µg/m³. Also, the average concentration of PM_{2.5} in

the classroom at MS during the teaching period was 22.1 µg/m³. This is 1.5 times higher PM_{2.5} concentration compared to the average PM_{2.5} concentration, recorded in the no-teaching period (14.8 µg/m³). In MS, the average PM₁₀ concentrations during classes were above daily limit values for 3 of 5 working days.

Table 2 Average PM_{2.5} levels and I/O ratios measured in the classrooms at MS and GM (PP - pupils present, PA - pupils absent)

MS working days						
Date	PM _{2.5} IN 24h µg/m ³	PM _{2.5} OUT 24h µg/m ³	PM _{2.5} IN/OUT 24h	PM _{2.5} IN PP µg/m ³	PM _{2.5} IN PA µg/m ³	PM _{2.5} IN PP/PA
21/01/19	15.5	22.2	0.7	15.5	16.1	1.0
22/01/19	24.5	22.6	1.1	28.7	16.3	1.8
23/01/19	17.2	26.5	0.6	28.5	12.9	2.2
24/01/19	18.8	19.8	1.0	25.3	17.9	1.4
25/01/19	12.0	14.6	0.8	12.7	10.7	1.2
Average	17.6	21.1	0.8	22.1	14.8	1.5
MS weekend days						
27/01/19	5.1	22.3	0.2	4.1	4.2	1.0
28/01/19	8.1	24.7	0.3	5.0	5.7	0.9
Average	6.6	23.5	0.3	4.5	5.0	0.9
GM working days						
Date	PM _{2.5} IN 24h µg/m ³	PM _{2.5} OUT 24h µg/m ³	PM _{2.5} IN/OUT 24h	PM _{2.5} IN PP µg/m ³	PM _{2.5} IN PA µg/m ³	PM _{2.5} IN PP/PA
13/03/23	4.0	12.8	0.3	3.9	3.0	1.3
14/03/23	4.7	19.7	0.2	6.6	3.8	1.7
15/03/23	8.5	18.1	0.5	12.5	6.1	2.0
16/03/23	8.3	8.6	1.0	11.7	7.7	1.5
17/03/23	7.6	9.1	0.8	8.7	9.3	0.9
Average	13.1	22.1	0.6	8.9	6.0	1.5
GM weekend days						
18/03/23	7.8	16.3	0.5	8.1	4.9	1.7
19/03/23	4.1	15.8	0.3	3.7	7.4	0.5
Average	6.0	16.0	0.4	5.9	6.1	1.1

The average PM_{2.5} levels measured in the classroom at GM was 13.1 µg/m³. At the same time, the average daily concentration of PM_{2.5} in the ambient air was 22.1 µg/m³. Also, the average concentration of PM_{2.5} in the classroom during the teaching period

was 8.9 µg/m³. This is 1.5 times higher average PM_{2.5} concentration compared with the PM_{2.5} concentration recorded in the no-teaching period (6.0 µg/m³). Changes in PM_{2.5} concentrations in the observed classrooms are shown in Figures 4 and 5.

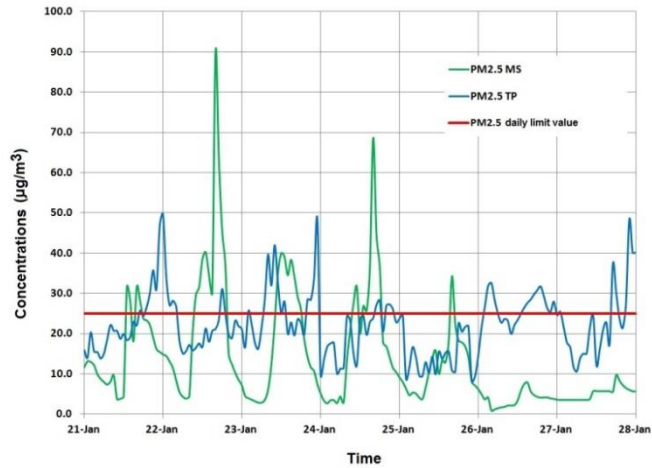


Figure 4 Line diagram of $PM_{2.5}$ measured in MS and in the outdoor air at TP

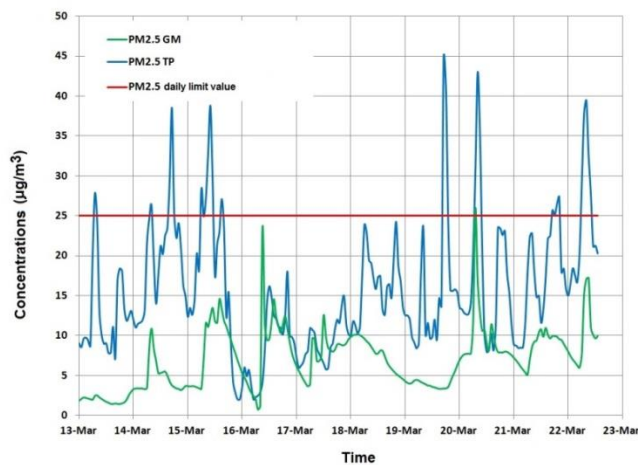


Figure 5 Line diagram of $PM_{2.5}$ measured in GM and in the outdoor air at TP

The PM_{10} levels measured in the MS and GM classrooms are comparable with previously reported PM_{10} levels, measured in schools in the Republic of Serbia and EU [12-15]. For example, the average PM_{10} levels in the classrooms in Thessaloniki was $118 \mu\text{g}/\text{m}^3$, and in the range of $75 - 203 \mu\text{g}/\text{m}^3$ in the classrooms in Athens [12]. As reported in [13], the PM_{10} levels measured in schools in Aveiro, Portugal, were 49.2 and $79.8 \mu\text{g}/\text{m}^3$. The same paper states that

the average PM_{10} I/O ratio was 2.4 and 1.84, which is comparable to our results. The average daily PM_{10} level measured in the city of Niš, at the Faculty of Occupational Safety in Niš, was $47.0 \mu\text{g}/\text{m}^3$, and at the primary school, Vožd Karađorđe in Niš was $54.6 \mu\text{g}/\text{m}^3$ [14]. Also, the average PM_{10} levels in two primary schools in Bor and Zlot in the heating season were $44.2 \mu\text{g}/\text{m}^3$ and $49.5 \mu\text{g}/\text{m}^3$, respectively [15].

4 CONCLUSION

This work presents the results of measurements the mass concentration of PM_{10} and $PM_{2.5}$ in the indoor air of two secondary schools in Bor during the heating period. The measurement results show that the average concentrations of suspended particles PM_{10} during the class period were 1.7 (GM) and 2.4 (MS) times higher than in the period without classes. The average concentrations of suspended particles $PM_{2.5}$ in both schools during the class period were 1.5 times higher than in the period without classes. In MS, the average PM_{10} and $PM_{2.5}$ concentrations during classes were above daily limit values for 3 of 5 working days. Limited ventilation in classrooms during the heating period and resuspension of particles are reasons that caused the high indoor PM concentrations during the teaching period in comparison to the PM concentrations in the no-teaching period. Thus, the appropriate measures should be prescribed to provide better air quality inside the schools, such as different cleaning and ventilation practice. Further study should be continued in the no-heating period to determine whether there are seasonal differences in levels of PM in the classrooms in comparison to the outdoor PM levels.

REFERENCES

- [1] Tasić V., Milošević N., Kovačević R., Petrović N., The analysis of Air Pollution Caused by Particle Matter Emission from the Copper Smelter Complex Bor (Serbia), *Chemical Industry & Chemical Engineering Quarterly*, 16 (2010) 219–228.
- [2] Tasić V., Milošević N., Kovačević R., Jovašević-Stojanović M., Dimitrijević M., Indicative Levels of PM in the Ambient Air in the Surrounding Villages of the Copper Smelter Complex Bor, Serbia, *Chemical Industry & Chemical Engineering Quarterly*, 18 (2012) 643–652.
- [3] Tasić V., Kovačević R., Maluckov B., Apostolovski-Trujić T., Cocić M., Matić B., Šteharik M., The content of As and Heavy Metals in TSP and PM_{10} Near Copper Smelter in Bor, Serbia, *Water Air Soil Pollut.*, 228 (2017) 230–236.
- [4] Official Gazette of Republic of Serbia, 2013, Regulation on the Conditions for Monitoring and Requirements of the Air Quality. (No 11/10, 75/10, 63/13) (in Serbian).
- [5] <https://www.who.int/publications/i/item/9789240034228> [accessed 12 June 2023]
- [6] Anderson H.R., Bremner S.A., Atkinson R.W., Harrison R.M., Walters S., Particulate Matter and Daily Mortality and Hospital Admissions in the West Midlands Conurbation of the United Kingdom: Associations with Fine and Coarse Particles, Black Smoke and Sulphate, *Occup Environ Med*, 58 (2001) 504–510.
- [7] Atkinson R.W., Fuller G.W., Anderson H.R., Harrison R.M., Armstrong B., Urban Ambient Particle Metrics and Health: A Time Series Analysis, *Epidemiology* 21 (2010) 501–511.
- [8] Pope C.A., Dockery D.W., Health Effects of Fine Particulate Air Pollution: Lines that Connect, *Journal of the Air and Waste Management Association* 56 (2006) 709–742.
- [9] Pope C.A., Burnett R.T., Thun M.J., Calle E.E., Krewski D., Ito K., Thurston G.D., Lung Cancer, Cardio-pulmonary Mortality, and Long-Term Exposure to Fine Particulate Air Pollution, *J Am Med Assoc*, 287 (2002) 1132–1141.

- [10] Franck U., Herbath O., Roder S., Schlink U., Bote M., Diez U., Kramer U., Lehmann, I., Respiratory Effects of Indoor Particles in Young Children are size dependent, *Sci. Total Environ.*, 409 (2011) 1621-1631.
- [11] V. Tasić, T. Apostolovski - Trujić, R. Kovačević, M. Jovašević - Stojanović, Measuring the Concentration of Suspended Particles (PM10) in the Indoor Environment Using the Automatic Monitors, *Mining and Metallurgy Engineering Bor*, No. 4/2015 pp.123-128, ISSN 2334-8836, doi: 10.5937/MMEB1504123T
- [12] Gemenetzi P., Moussas P., Arditoglou A., Samara C., Mass Concentration and Elemental Composition of Indoor PM2.5 and PM10 in University Rooms in Thessaloniki, Northern Greece, *Atmospheric Environment*, Vol. 40, (2006) 3195–3206.
- [13] Pegas P.N. Nunes T., Alves C., Indoor and Outdoor Characterization of Organic and Inorganic Compounds in City Centre and Suburban Elementary Schools of Aveiro, Portugal, *Atmospheric Environment*, Vol. 55, (2012) 80-89.
- [14] Kovačević R., Tasić V., Živković M., Živković N., Đorđević A., Manojlović D., Jovašević-Stojanović M., Mass Concentrations and Indoor-Outdoor Relationships of PM in Selected Educational Buildings in Niš, Serbia, *Chemical Industry & Chemical Engineering Quarterly*, Vol. 21 (1/II) (2015) 149-158.
- [15] Lazović I., Jovašević-Stojanović M., Živković M., Tasić V., Stevanović Ž., PM and CO₂ Variability and Relationship in the Different School Environments, *Chemical Industry & Chemical Engineering Quarterly*, Vol. 21 (1/II) (2015) 179-187.